

RADCO TEST REPORT
Test Report No. RAD-2529
Project No. C-7621
Lab No. TL-1911

**TESTS ON STRETCH CEILING SYSTEMS
PER
UNIFORM BUILDING CODE**


Prepared for

NEWMAT STRETCH CEILING SYSTEMS
25 Surryhill Place
Huntington, NY 11743

by


RADCO
Resources, Applications, Designs and Controls, Inc.
Listing and Testing Division
3220 E. 59th Street
Long Beach, CA 90805
Telephone: 562-272-7231
Facsimile: 562-529-7513

Prepared by:

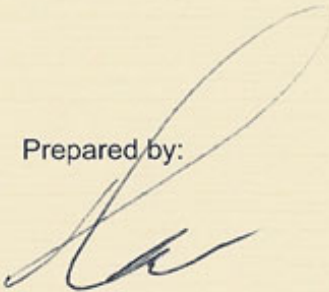

Thomas Clark, Manager
Physical Testing

Submitted by:

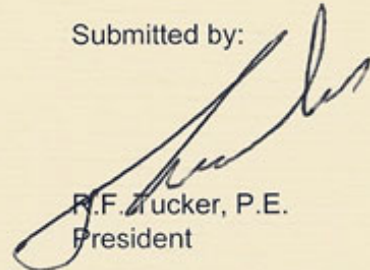

R.F. Trucker, P.E.
President

Issued: June 2000

TABLE OF CONTENTS

1.0	INTRODUCTION	1
2.0	MATERIAL DESCRIPTION	1
3.0	TEST PROCEDURES AND RESULTS	1
4.0	CONCLUSION	1

APPENDIX A

PHOTOGRAPHS

1.0 INTRODUCTION

At the request of Newmat Stretch Ceiling Systems, the tests listed in Section 3.0 below were conducted on their stretch ceiling system in accordance with the Uniform Building Code 1997, Section 801.2. Samples for testing were prepared by Newmat and shipped to RADCO's testing facility in Long Beach, California. The samples were received on May 31, 2000.

2.0 MATERIAL DESCRIPTION AND TEST PROGRAM

A single material identified as Newmat M15 (white matte) was tested in two different support frames. One M15 membrane was tested in a classical PVC white Matte extrusion frame, and a second M15 membrane was tested in a classical aluminum extrusion frame.

3.0 TEST PROCEDURES AND RESULTS


Criteria for passing is stated in the code as, *"to show that materials when cemented or otherwise fastened in place will not readily become detached when subject to room temperatures of 300 ° F (149 ° C) for 25 minutes"*. The frames were placed in an oven preheated to 300° F (149° C) . After 25 minutes the frames were removed and examined.

4.0 CONCLUSION

The Newmat M15 (white matte) stretch ceiling systems in two different support frames were tested. Both the M15 membrane tested in a classical PVC white Matte extrusion frame, and the M15 membrane tested in a classical aluminum extrusion frame passed the requirements of the Uniform Building Code 1997, Section 801.2.

*** END OF REPORT ***

SAMPLE PLACED IN OVEN AT 300° F FOR 25 MINUTES

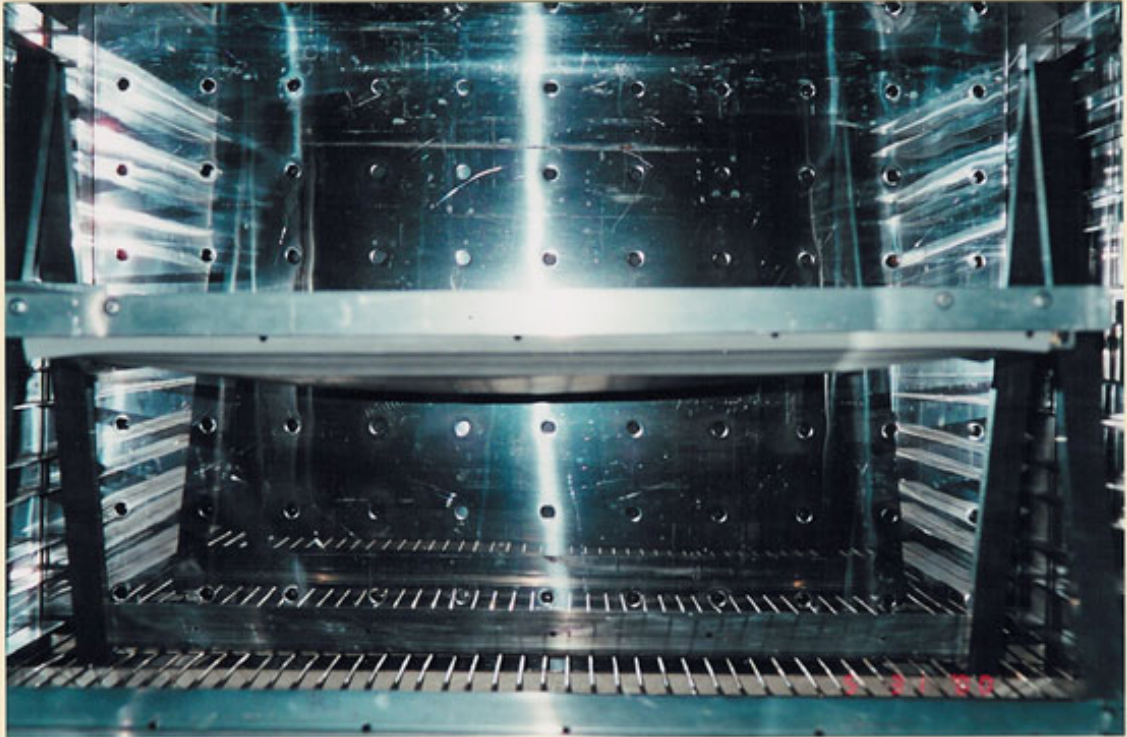

SAMPLE MOUNTED ON SUPPORT FRAME

